



## EC-Net<sup>AX</sup> Supervisor Versions and Drivers

EC-Net <sup>AX</sup> Supervisor	Basic EC-Net <sup>AX</sup> Supervisor; all EC-BOS <sup>AX</sup> must have EC-NC-SP-XXX for connectivity to EC-Net <sup>AX</sup> Supervisor
EC-Net <sup>AX</sup> Supervisor-SBS	Small Building System version of EC-Net <sup>AX</sup> Supervisor with a three EC-BOS <sup>AX</sup> station limit
EC-S <sup>AX</sup> -SBS-EXUP	Upgrade from EC-Net <sup>AX</sup> Supervisor-SBS to a full EC-Net <sup>AX</sup> Supervisor
EC-WP <sup>AX</sup>	Additional copy of EC-Net <sup>AX</sup> Pro

### Optional Database Drivers (for EC-Net<sup>AX</sup> Supervisor only)

EC-S-DB-SQL	Microsoft SQL Database Driver
EC-S-DB-MYSQL	MYSQL Database Driver
EC-S-DB-DB2	IBM DB2 Database Driver
EC-S-DB-ORCL	Oracle Database Driver

### Open System Drivers (for EC-Net<sup>AX</sup> Supervisor only)


EC-DR-S-BAC <sup>AX</sup>	EC-Net <sup>AX</sup> Supervisor BACnet driver. Includes license for 500 BACnet points
EC-DR-S-BAC-500	Additional 500 point block for the EC-Net <sup>AX</sup> Supervisor BACnet driver
EC-DR-S-OPC <sup>AX</sup>	EC-Net <sup>AX</sup> Supervisor OPC driver. Includes license for 500 OPC points
EC-DR-S-OPCC-500	Additional 500 point block for the EC-Net <sup>AX</sup> Supervisor OPC driver
EC-DR-S-MDB <sup>AX</sup>	EC-Net <sup>AX</sup> Supervisor Modbus TCP driver. Includes license for 500 Modbus TCP points
EC-DR-S-MDB-500	Additional 500 point block for the EC-Net <sup>AX</sup> Supervisor Modbus TCP driver
EC-DR-S-SNMP <sup>AX</sup>	EC-Net <sup>AX</sup> Supervisor SNMP driver. Includes license for 500 SNMP points
EC-DR-S-SNMP-500	Additional 500 point block for the EC-Net <sup>AX</sup> Supervisor SNMP driver
EC-DR-S-OBIX <sup>AX</sup>	EC-Net <sup>AX</sup> Supervisor oBIX driver for non-Niagara point data. Includes 500 points.
EC-DR-S-OBIX-500	Additional 500 point block for the EC-Net <sup>AX</sup> Supervisor oBIX driver

## Platform Requirements

Processor:	Intel Pentium IV, 2 GHz or higher
Operating System:	Microsoft Windows XP Professional, Windows 2003 Server (if Microsoft IIS is disabled), Vista Ultimate, Windows 7 Mozilla Firefox or Internet Explorer 5.0 or later
Memory:	1 GB minimum, 2GB or more recommended for large systems
Hard Drive:	10 GB minimum, 25 GB for applications that need more archiving capacity
Display:	Video card and monitor capable of displaying 1024 x 768 pixel resolution or greater
Network Support:	Ethernet adapter (10/100MB with RJ-45 connector)
Network Connection:	Full time high-speed ISP connection recommended for remote site access (i.e. T1, ADSL, cable modem); 56KB modem minimum

## Typical Architecture

Truly Open Solutions Provide Flexibility with Interoperability Now and in the Future.

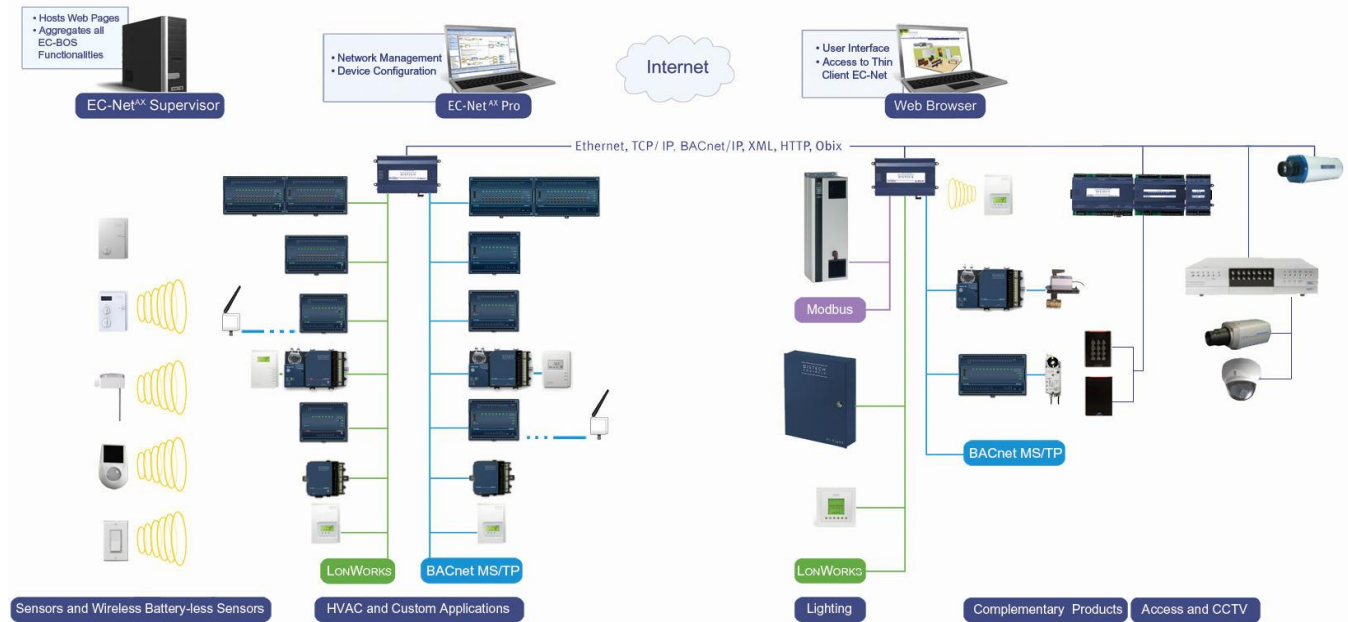

Specifications subject to change without notice.

Distech Controls and the Distech Controls logo are trademarks of Distech Controls, Inc.; Niagara<sup>AX</sup> Framework is a trademark of Tridium Inc.; LONWORKS is a registered trademark of Echelon Corporation; BACnet is a registered trademark of ASHRAE; all other trademarks are property of their respective owners. Products or features contained herein may be covered by one or more U.S. or foreign patents.



05DI-DSNETAX-30

EC-Net<sup>AX</sup> Supervisor

www.distech-controls.com